

**SANDEEP  
FIRE SERVICES**

Fire safety on, accidents gone

## **SANDEEP FIRE SERVICES**

Manufacturer and suppliers for fire extinguisher and safety equipment  
ISO 9001-2015 / Maharashtra fire services authorised licence agency

# **CERTIFICATE**

## **TO WHOMSOEVER IT MAY CONCERN**

This is to certify that The Principal, Gandhi Education Society's Krantiagrani Dr. G.D. Babu Lad Mahavidyalaya, Kundal. Has been New Fire Extinguisher (6 nos) system by us and is tested and certified by us. It has proper safety provisions against fire. As per Hazardous required Fire Extinguisher is instead & up to date today.

This certificate is given on demand of applicant.

Date :- 13/02/2024

Place :- Karad

For SANDEEP FIRE SERVICES.

*M/s. Sandeep Fire Services*

**PROPRIETOR**

Sandeep L Khatmode.  
(Fire & Safety Engg)  
Auth. sign

**Licence No MFS-LA/RF-88 & RD – 83**

Head Ofc-S.R. No. 84/2, Saidapur, Sambhaji Nagar, Medha Road, Post kondave, Tal- Dist - Satara 415002

☎ 9923236015 / 8208543278 ✉ sandeep@sandeepfire.com 🌐 www.sandeepfire.com



**Principal**  
Krantiagrani Dr. G. D. Babu Lad  
Mahavidyalaya, Kundal.  
Tal. Palus, Dist. Sangli.



**Principal**  
Krantiagrani Dr. G. D. Babu Lad  
Mahavidyalaya, Kundal.



# SANDEEP FIRE SERVICES

AUTHORISED LICENSE AGENCY NO- MFS-LA/2020/RF-55, 2020RD-45

ISO 9001 2015

9923236015 / 8208543278

MANUFACTURE & SUPPLIER FOR FIRE EXTINGUISHER & SAFETY EQUIPMENT

Head Office - S.R.no 84/2, Saidapur, Sambhaji Nagar, Medha Road, Post Kondave, Tal-Dist Satara. 415 002

E-mail-sandip\_fire@ymail.com

Certificate No: SFS/  
Feb - 15

## TEST WARRANTY CERTIFICATE

Date-  
3/02/2024

*This is certify that following Fire Extinguisher have been tested by us as per relevant IS specification and supplied to*

M/s. Gandhi Education Society's

Krantiagrani Dr. G.D. Babu Lad Mahavidyalaya, Kundal.

Sr. No.	Type of Extinguisher	Capacity	Qty.	IS No.	Remarks
1	ABC Dry Powder (Store Pressure/Co2 cartridge) Type Fire Extinguisher.	4 KG	05 Nos	15683	NEW Installation
2	Dry Chemical Powder (Store Pressure/Co2 cartridge) Type Fire Extinguisher.				
3	Water (Store Pressure/Co2 cartridge) Type Fire Extinguisher.				
4	Carbon Dioxide Type Fire Extinguisher	2 KG	05 Nos	15683	NEW Installation
5	Mechanical Foam (AFFF) (Store Pressure/Co2 cartridge) Type Fire Extinguisher.				
6					

Checking / Refilling / H P Test/  
New Installation Date:

13/02/2024

Next Due Date:

12/02/2025

*Further we certify that the above material are made of best quality in workmanship free from all defects in material and workmanship, if any inconsistency in the performances of the material in that event we undertake free repairs or replacement during the warranty period*


For SANDEEP FIRE SERVICES

Auth. Sign



Principal



Krantiagrani Dr. G. D. Babu Lad  
Mahavidyalaya, Kundal.  
Tal. Palus, Dist. Sangli



Principal

Krantiagrani Dr. G. D. Babu Lad  
Mahavidyalaya, Kundal.

Gandhi Education Society's  
Krantiagrani Dr. G. D. Babu Lad Mahavidyalaya, Kundal  
Campus Security

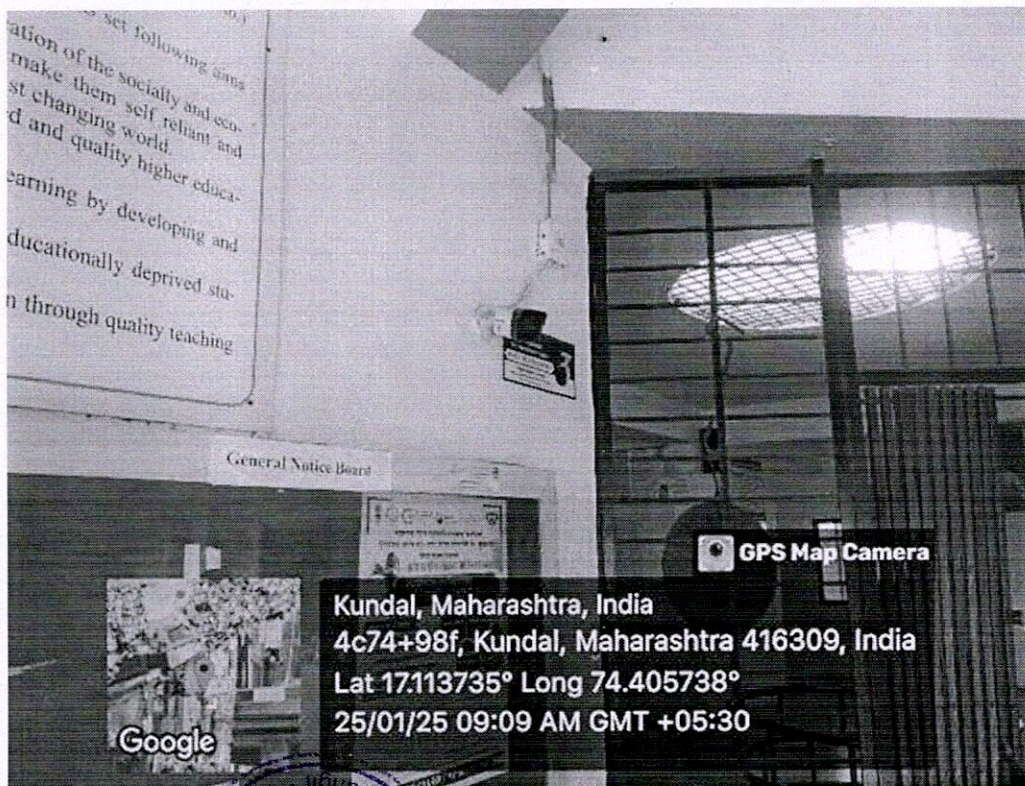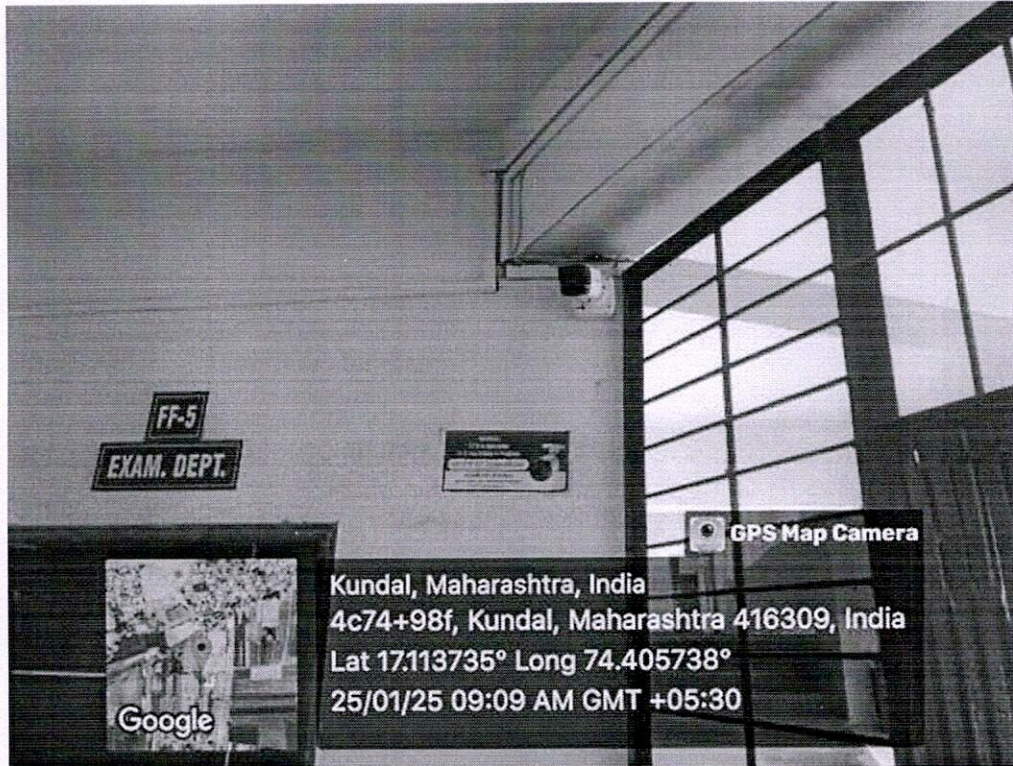

*[Signature]*  
Principal  
Krantiagrani Dr. G. D. Babu Lad  
Mahavidyalaya, Kundal.